

# Air Cooled Aftercooler Series HAA

Series HAA can cool high temperature compressed air from compressors down to 40°C or less and efficiently remove moisture from the air. The air cooled aftercooler does not require cooling equipment and is free from concerns such as water supply cut-off or freezing. Maintenance is easy and the running cost is reasonable.

Compact size and lightweight  
Uses minimal floor space  
Built-in drain separator  
Dust-protecting filter optional




HAA15



HAA7

## Working Principle

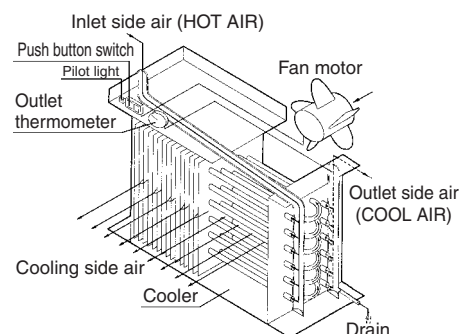

## Model/Standard Specifications

Model		HAA7	HAA15	HAA22	HAA37		
Rated performance	Max. flow capacity (ℓ/min (ANR)) <sup>(1)</sup>	1000	2200	3300	5700		
	Inlet air temperature (°C)	70					
	Inlet air pressure (MPa)	0.7					
	Ambient temperature (°C)	32					
	Outlet air temperature (°C)	40					
Operating range	Fluid	Compressed air					
	Inlet air temperature (°C)	5 to 100					
	Inlet air pressure (MPa)	0.05 to 1.0 (With auto drain: 0.15 to 1.0)		0.05 to 0.97 (With auto drain: 0.15 to 0.97)			
	Ambient temperature (°C)	2 to 50					
Electrical specifications	Installation features		Indoor				
	Power source		Single phase 100 VAC (50/60 Hz)	Single phase 200 VAC (50/60 Hz)	Single phase 100 VAC (50/60 Hz)	Three phases 200 VAC (50/60 Hz)	Three phases 200 VAC (50/60 Hz)
	Power consumption (W)	50 Hz	38	55	50	90	132 x 2
		60 Hz	46	65	60	130	170 x 2
	Current (A)	50 Hz	0.46	0.23	0.8	0.4	1.44
		60 Hz	0.52	0.26	0.9	0.35	0.45
Proof pressure (MPa)		1.5					
Cooling fan dia. (mm)		255	300	400	350 x 2 pcs.		
Cooler		Aluminum plate tube with fins					
Port size for inlet/outlet air		Rp 3/4 socket	1B union	1 1/2B union			
Port size for drain outlet piping (Auto drain)		Rc 3/8 (Rc 3/8)			Rc 1/2 (Rc 3/8)		
Mass (kg)		18	24	36	55		
Coating color		Munsell N-8 (White), Munsell 2.5PB5/8.5 (Blue)					
Applicable compressor (kW) <sup>(2)</sup>		7.5	15	22	37		
Standard equipment	Thermometer for outlet air temp. (1 pc.)	—	●	●	●		
	Drain valve (1 pc.)	3/8B			1/2B		
Accessory <sup>(3)</sup>	Union (2 pcs.)	—	1B	1 1/2B			

Note 1) ANR indicates the flow rate converted to the value at 20°C under the atmospheric pressure and the state of relative humidity 65%.

Note 2) Based on discharge rate and discharge temperature (70°C) of screw type compressors.

Note 3) The accessories should be mounted by user.

## Option Specifications

Applicable model	HAA7	HAA15	HAA22	HAA37
With terminal	●	●	●	(Standard) *

\* HAA37 has an external push button with terminal.

## Accessory (Option)

Applicable model	HAA7	HAA15	HAA22	HAA37
Auto drain		AD402-03		AD402-04
Dust-protecting filter	HAA7-F	HAA15-F	HAA22-F	HAA37-F
Mounting bench	HAA7-S	HAA15-S	HAA22-S	HAA37-S

\* The accessories should be mounted by user.

## Model Selection (Flow Capacity ℓ/min (ANR))

Model	HAA7	HAA15	HAA22	HAA37
Inlet air temperature	50°C	1500	4000	6000
	70°C	1000	2200	3300
	100°C	700	1500	2200

Conditions: Outlet temperature 40°C, Ambient temperature 32°C, Air pressure 0.7 MPa

HAA  
HAW

AT

IDF  
IDU

IDFA

IDFB

ID

IDG

AMG

AFF

AM

AMD

AMH

AME

AMF

SF

SFD

LLB

AD□

GD

# Series HAA

## How to Order

**HAA 15 - 10 1 - [ ] - [ ]**

**Basic size**

Symbol	Applicable air compressor
7	7.5 KW
15	15 KW
22	22 KW
37	37 KW

**Port size**

Symbol	Size	Applicable model
06	Rp 3/4 socket	HAA7
10	1 <sup>B</sup> union	HAA15
14	1 1/2 <sup>B</sup> union	HAA22, 37

**Suffix**

Symbol	Description
Nil	—
T	With terminal (Provided as standard for HAA37.)

**Accessory (Option)**

Symbol	Description
Nil	—
D	Auto drain
F	Dust-protecting filter
S	Mounting bench

**Source voltage**

Symbol	Voltage	Applicable model
1	Single phase 100 VAC	HAA7, 15
2	Single phase 200 VAC	HAA7
3	Three phase 200 VAC	HAA15, 22, 37

## How to Calculate Outlet Air Temperature


Outlet air temperature can be calculated with inlet air temperature, ambient temperature and amount of air in the following procedure.

(Example) Inlet air temperature: 100°C, Ambient temperature: 20°C, Amount of air: 2000 ℓ/min (ANR), Air pressure: 0.7 MPa, Model: HAA22-14

### Outlet Air Temperature at Above Conditions

- Use outlet air temperature of 38.5°C from outlet air temperature table. At this time correction factor line becomes ①.
- To get correction factor of 1.35 use ambient temperature correction factor ① at 20°C.
- To get outlet air temperature divide 38.5°C from (1) by 1.35 from (2).  
Outlet temperature = 38.5 ÷ 1.35 = 28.5°C

Correction Factor by Ambient Temperature

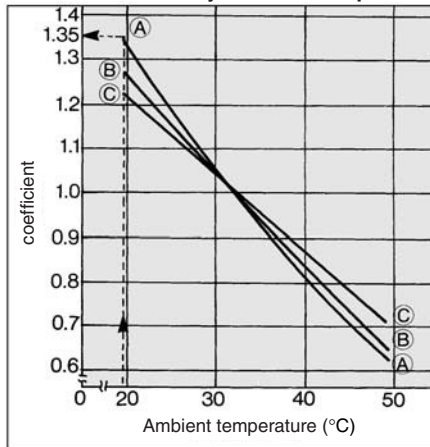

## Outlet Air Temperature

Model	Correction factor	Air flow (ℓ/min (ANR))	Inlet air temperature (°C)		
			50°C	70°C	100°C
HAA7	①	500	34.5	35	35.5
	②	1000	38	40	42.5
	③	1500	40	44	47.5
HAA15	①	1000	33	35.5	36
	②	2200	36.5	40	42.5
	③	3000	38	42	44
HAA22	①	2000	34	37	38.5
	②	3300	36	40	42.5
	③	4000	37	41.5	45
HAA37	①	4000	34	38	39
	②	5700	35	40	43
	③	7000	36	42	45

Conditions: • Air pressure 0.7 MPa, Ambient temperature 32°C.  
• Inlet air temperature 50°C is saturated air. At 70°C or more, it is humid air with dew point 67°C.

## ⚠ Precautions

Be sure to read before handling. Refer to front matters 42 and 43 for Safety Instructions and pages 6 to 8 for Air Preparation Equipment Precautions.

### Caution on Design

#### ⚠ Caution

- Do not to obstruct the aftercooler's vent inlet and outlet, and install the equipment more than 20 cm away from the walls or other equipment.
- Install the aftercooler in a location that facilitates maintenance and inspection.
- Install the aftercooler in a location with minimal vibrations.
- Ventilate the area because the surrounding temperature increases due to the exhaust heat from the aftercooler.
- The air cooled type aftercooler cannot be used in a location in which the temperature exceeds 50°C. In such a case, use a water cooled type aftercooler instead.
- The maximum allowable temperature of the inlet air is 100°C. If the inlet air exceeds this temperature, select an appropriate water cooled style aftercooler.
- Prevent fins from becoming clogged. Do not use this aftercooler in an area that has viscous dust (electrostatic paint powder, oily particles, etc.). If it must be used under such conditions due to unavoidable circumstances, please contact SMC beforehand.

### Mounting


#### ⚠ Caution

- Do not interchange the connections to the compressed air inlet and the compressed air outlet. When tightening the air inlet and outlet piping, make sure to use a pipe wrench to hold the inlet and outlet nozzles of the product.
- Connect a drain pipe because drainage is created when the compressed air is cooled.
- The drain pipe must have a minimum pipe bore of 10 mm, and a maximum length of 5 m (when installing an optional auto-drain).

### Maintenance


#### ⚠ Caution

- Inspect the cooler at least once a week and clean it to prevent it from becoming obstructed.
- Discharge the drainage on a regular basis in accordance with the amount of drainage that is created. (Use of an optional auto drain is recommended for automatic discharge.)

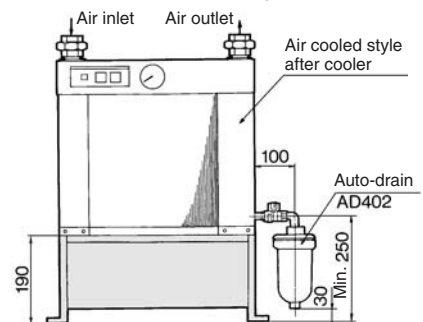

If the aftercooler is equipped with an auto-drain, the following mounting frame is necessary. Mounting frame (Option: Refer to page 11, Accessories.)

## Flow Characteristics Air pressure 0.7 MPa

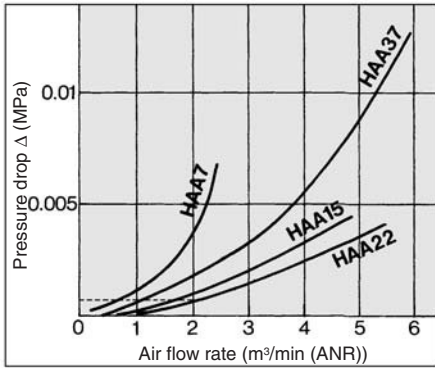


(Example) To get pressure drop at 0.3 MPa of air pressure, 2000 ℓ/min (ANR) of air flow, and model HAA22, use  $\Delta P = 0.0007$  MPa at 0.7 MPa from the table and convert  $P_1$  to 0.3 MPa.


$$\begin{aligned} \text{Pressure drop} &= \frac{(0.7 + 0.1013) \times \Delta P}{P_1 + 0.1013} \\ &= \frac{0.8013 \times 0.0007}{0.3 + 0.1013} \\ &= 0.0014 \text{ MPa} \end{aligned}$$

## Dimensions


### HAA7

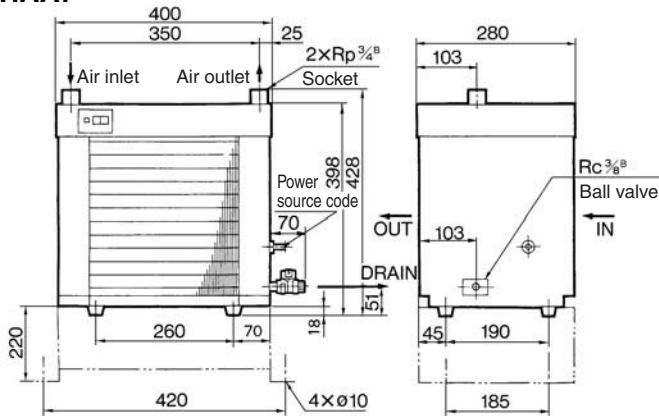

### HAA37

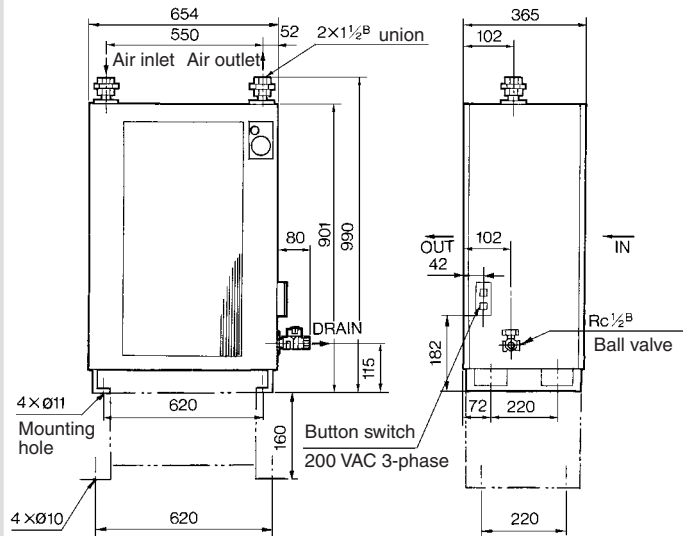

### HAA15/22

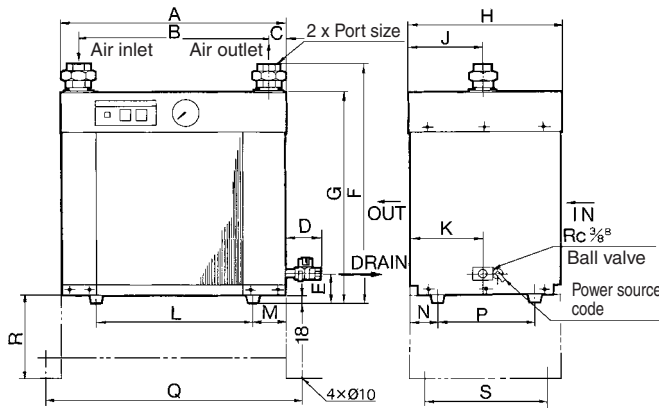

Model	Port size	A	B	C	D	E	F	G	H	J	K	L	M	N	P	Q	R	S
HAA15	1 <sup>B</sup> union	460	394	33	70	59	485	428	320	150	150	320	70	58	200	480	220	225
HAA22	1 1/2 <sup>B</sup> union	588	484	52	70	60	580	505	333	150	150	400	94	65	200	610	220	238

- HAA
- HAW
- AT
- IDF
- IDU
- IDFA
- IDFB
- ID
- IDG
- AMG
- AFF
- AM
- AMD
- AMH
- AME
- AMF
- SF
- SFD
- LLB
- AD
- GD